


NOTES:
 1. DETAILS TO BE USED IN CONJUNCTION WITH STANDARD GUIDE SPECIFICATIONS CONTAINING REQUIREMENTS FOR NAILERS, INSULATION, SLIPSHEETS, ETC.

2. PVC EDGE SEALANT IS REQUIRED ON ALL CUT EDGES OR NON-ENCAPSULATED EDGES OF REINFORCED MEMBRANE. THIS INCLUDES FACTORY CUT MEMBRANE.

3. ACCORDING TO PROJECT CONDITIONS, THE SPECIFIER AND/OR APPLICATOR MUST DETERMINE THE REQUIRED VERTICAL FLASHING HEIGHT BASED ON REGIONAL CLIMATIC CONDITIONS.

4. COATED METAL FLASHINGS MUST EXTEND UNDER A MINIMUM OF TWO (2) COURSES OF SHINGLES.

5. THE ROOFING SHEET MAY BE ATTACHED WITH APPROVED FASTENERS AND PLATES AS A BASE TIE-IN. SEE DETAIL MHP-120.

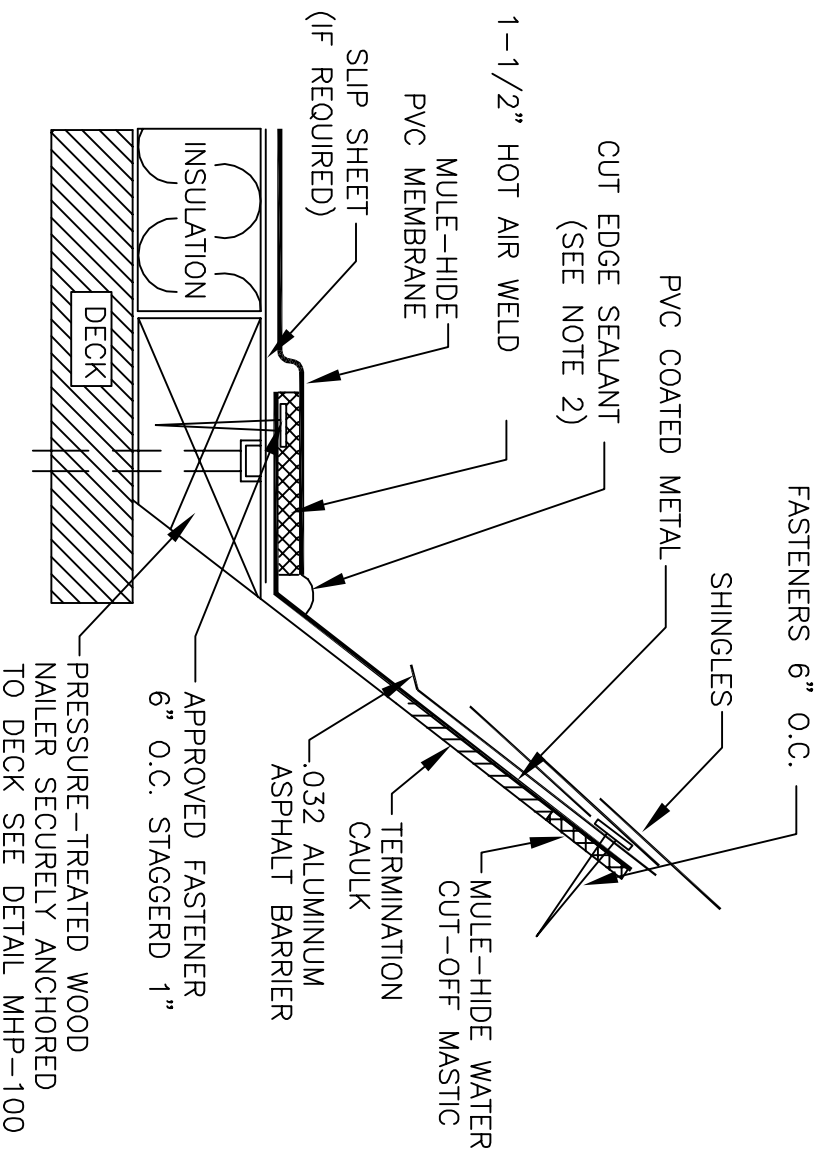

MULE-HIDE

PRODUCTS CO., INC.

04/01/2007

COATED METAL TRANSITION TO SHINGLE ROOF SYSTEMS:

ALL PVC

DETAIL NO:

MHP-161