


NOTES

1. THIS DETAIL TO BE USED IN CONJUNCTION WITH STANDARD GUIDE SPECIFICATIONS CONTAINING REQUIREMENTS FOR NAILERS, INSULATION, ETC.
2. CURB FLASHING SHOULD BE MINIMUM OF 8" HIGH WHERE POSSIBLE.
3. SEALANT IS REQUIRED BEHIND TPO COATED METAL WHEN SURFACE MOUNTED COUNTERFLASHINGS ARE USED.

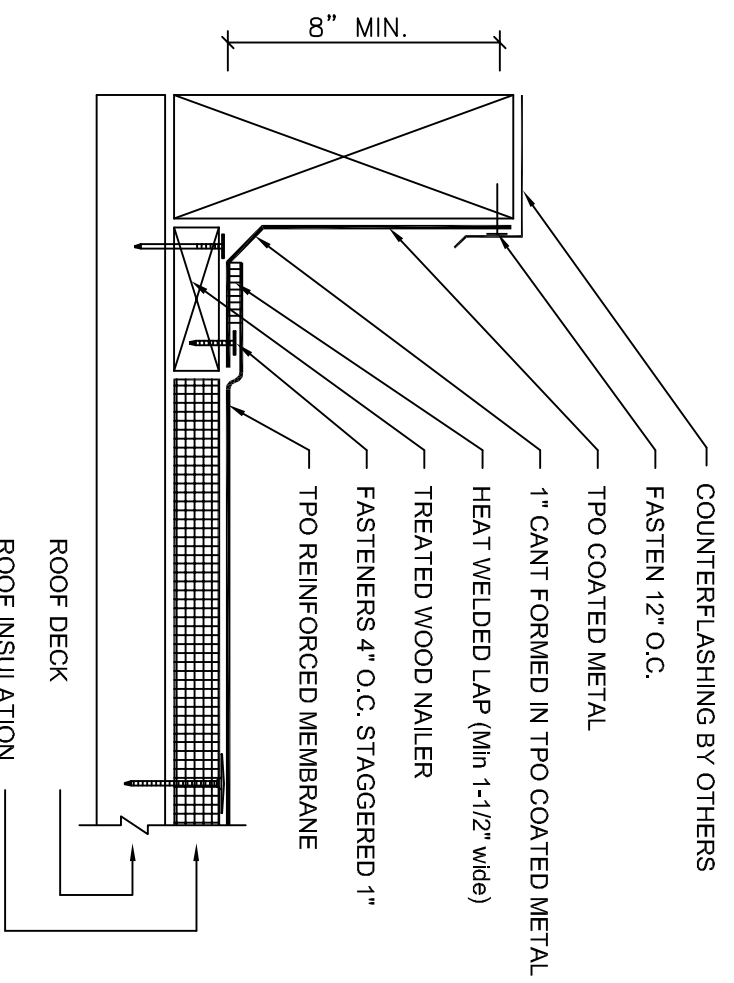

M-H APPROVED SEALANT BEHIND COATED METAL - SEE NOTE 3

MULE-HIDE

PRODUCTS CO., INC.
2006

CURB FLASHING - TPO COATED METAL W/CANT

TPO SYSTEMS: ALL

DETAIL NO:

MHT-UN-501A